



**GARDINER CITY COUNCIL  
AGENDA ITEM INFORMATION SHEET**



<b>Meeting Date</b>	<b>01/03/2024</b>	<b>Department</b>	<b>City Manager</b>
<b>Agenda Item</b>	<b>4o. Advise and Consent for Phase 2 of the Wastewater plant upgrades</b>		
<b>Est. Cost</b>	<b>\$2.9 million</b>		

**Background Information**

At the last meeting Joe Ducharme from Hoyle Tanner and Director Clark made a presentation on Phase 2 of the Waste Water treatment plant upgrades that are necessary. We are asking for consent to move forward with the project and consent to apply for funding through USDA-Rural Development loans to fund the project. With USDA-RD for phase 1 we received a 15% grant which it looks like we will receive again. We will also be applying for offsetting grant funding through various federal agencies. One thing to remember is that our most recent rate increase to the minimum was to help fund this large project.

<b>Requested Action</b>	'I move to approve moving forward with Phase 2 of the WasteWater treatment plant upgrades and approve applying for funding through the USDA-Rural Development funding program.'
<b>City Manager and/or Finance Review</b>	City Manager approves this action
<b>Council Vote/ Action Taken</b>	
<b>Departmental Follow-Up</b>	

<b>City Clerk Use Only</b>	1 <sup>st</sup> Reading _____	Advertised _____	<b>EFFECTIVE DATE</b> _____
	2 <sup>nd</sup> Reading _____	Advertised _____ w/in 15 Days	
	Final to Dept _____	Updated Book _____	Online _____

# Gardiner WWTF Phase 2 Improvements

City of Gardiner, Maine  
Presentation to City Council



By: Joe Ducharme, Jr., PE

December 6, 2023

Trusted Experts | Innovative Results

# Planning for the Future


## WWTF History

- Constructed 1980-82
- Limited Improvements 1987 / 2005 / CSO
- Phase 1 Upgrade – 2018-2022
- Phase 2 Upgrade – 2024-2025



Kennebec River

# Phase 1 Timeline

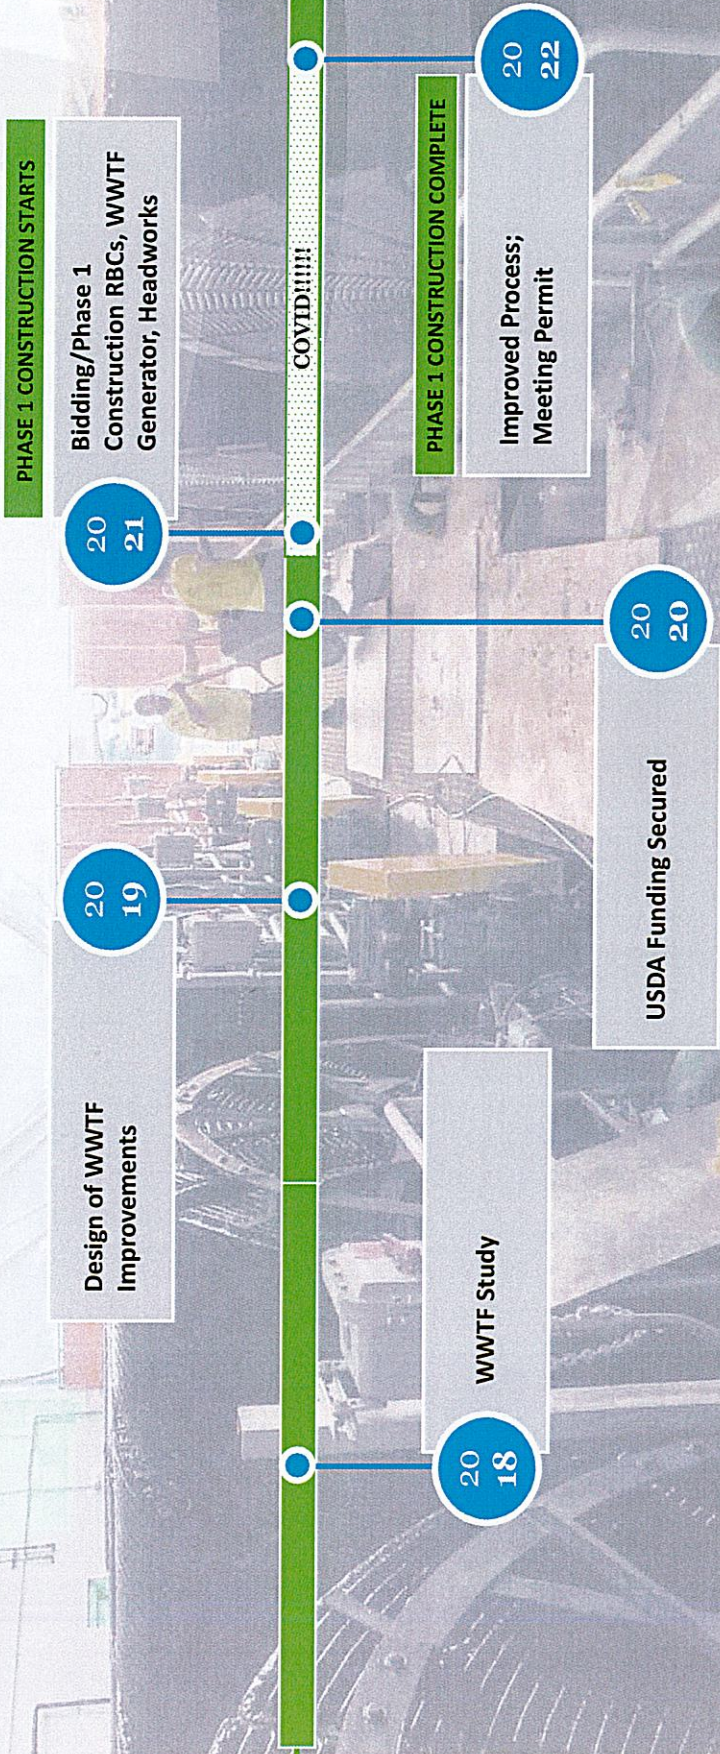




# Phase 2 Improvements

- Electrical Instrumentation & Controls (SCADA)
- MAPS Generator & Motor Control Center
- Blower Upgrades
- Chemical Feed System Upgrade
- Roof Repairs
- New Boiler
- CCTV Sewer Maintenance Trailer
- Pump Station 1 thru 5 Electrical Improvements

Trusted Experts | Innovative Results

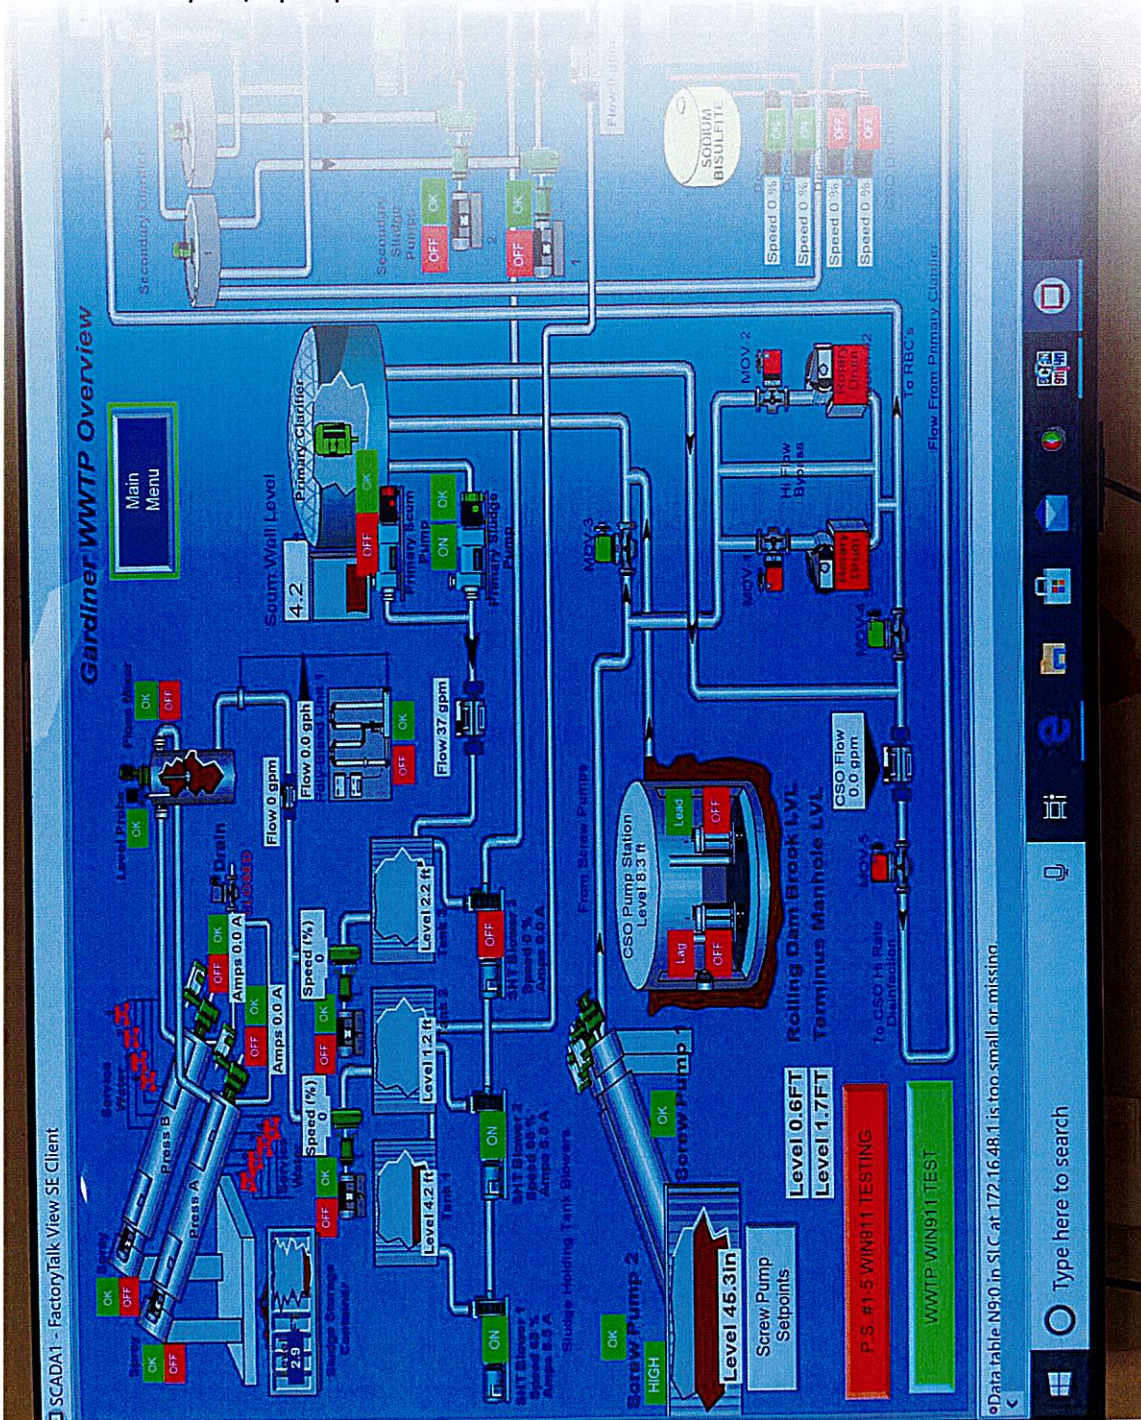


# Why do Phase 2 Now?




- Obsolete Equipment
- Operator Safety
- System Reliability
- Energy Efficiency
- Permit Compliance
- Inflation

ENR CCI Jan 2021-July 2025 Projection

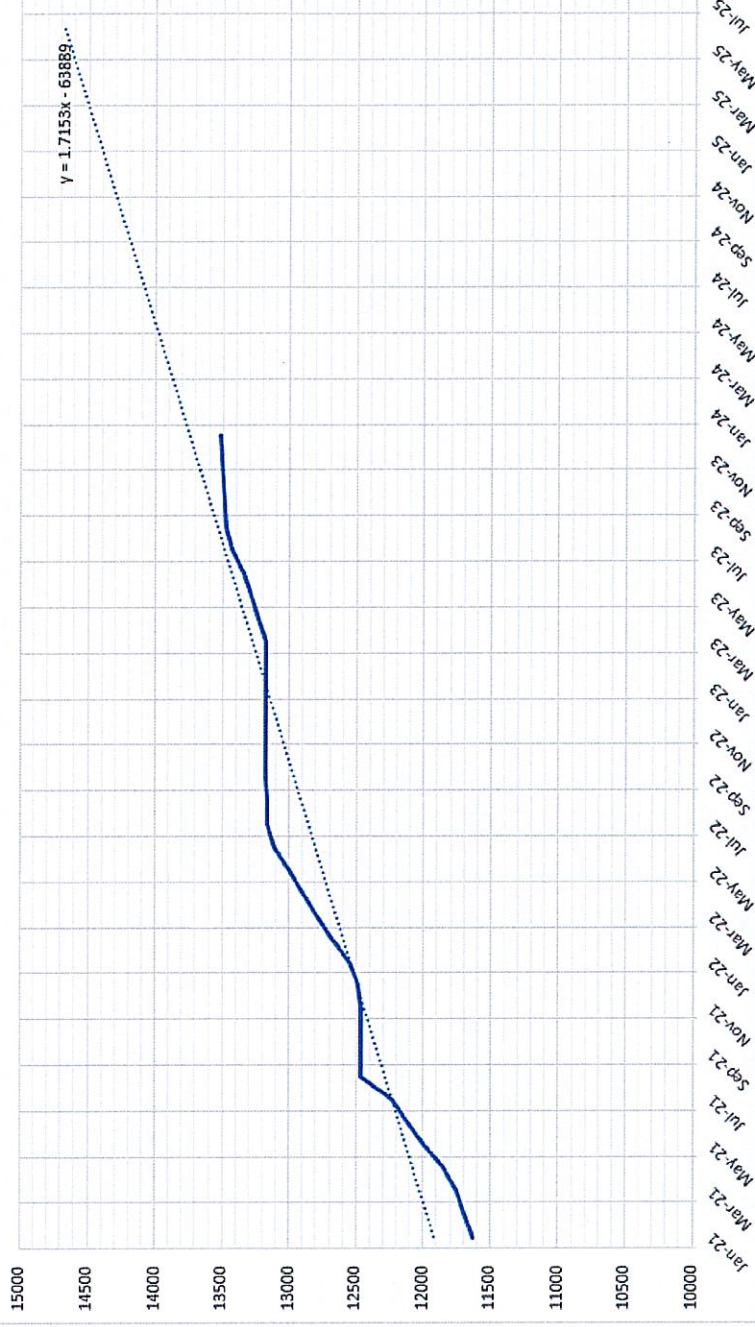

# Longevity of the Improvements

- Process Reliability Secured
- Major Components Last from 10-20 Years or more
- Routine Maintenance Extends Longevity
- Best Approach is to Maintain What You Have & Plan for the Future

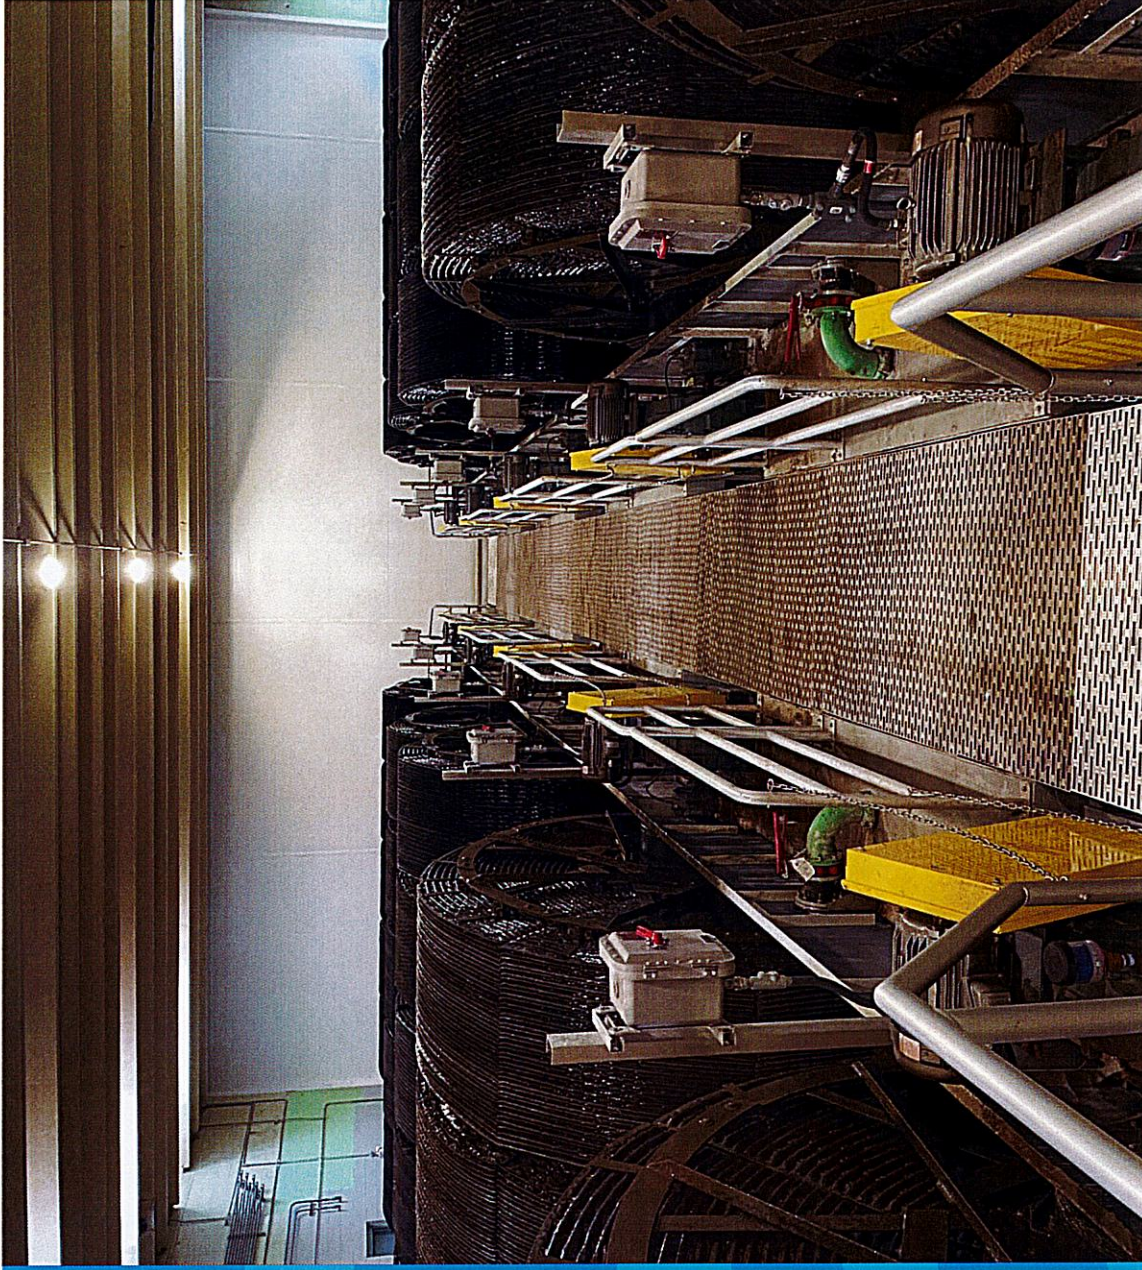

# Phase 2 Projected Cost




Improvement	Cost
Electrical, Instrumentation & Controls (SCADA)	\$0.875M
MAPS Generator & Motor Control Center	\$0.550M
Blower Upgrades / Chemical Feed System Upgrades	\$0.625M
Roof Repairs / New Boilers / CCTV Sewer Maintenance Trailer	\$0.300 M
Pump Station One thru Five Electrical/Motors/Controls (SCADA)	\$0.550 M
<b>Total</b>	<b>\$2.900 M</b>






# Phase 2 Timeline

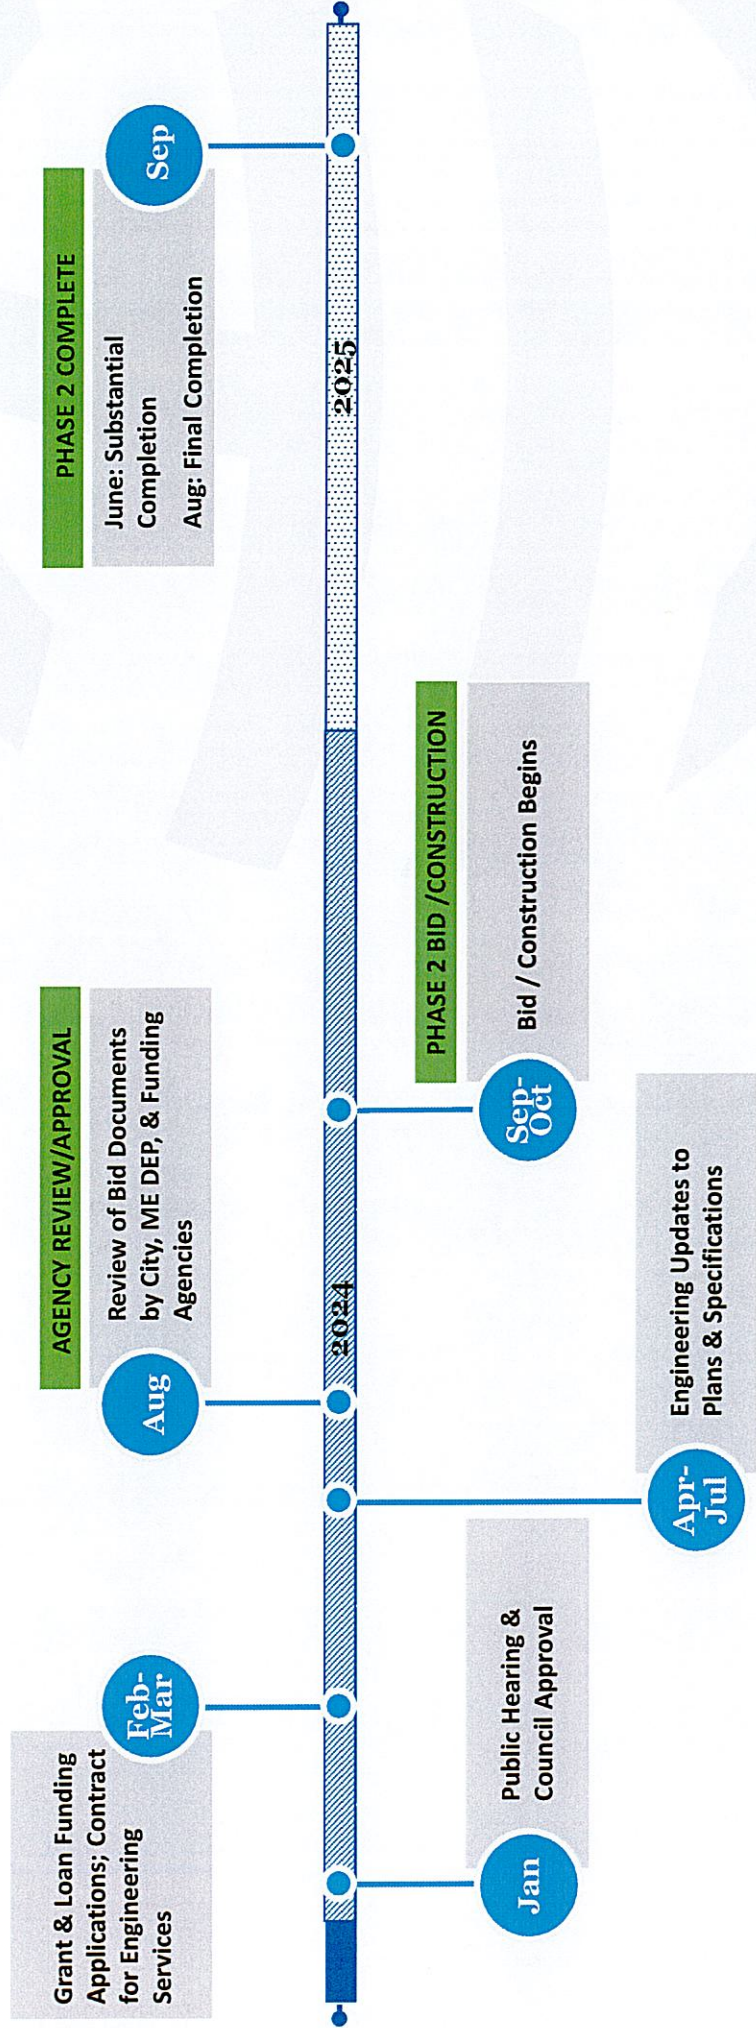

# Next Steps

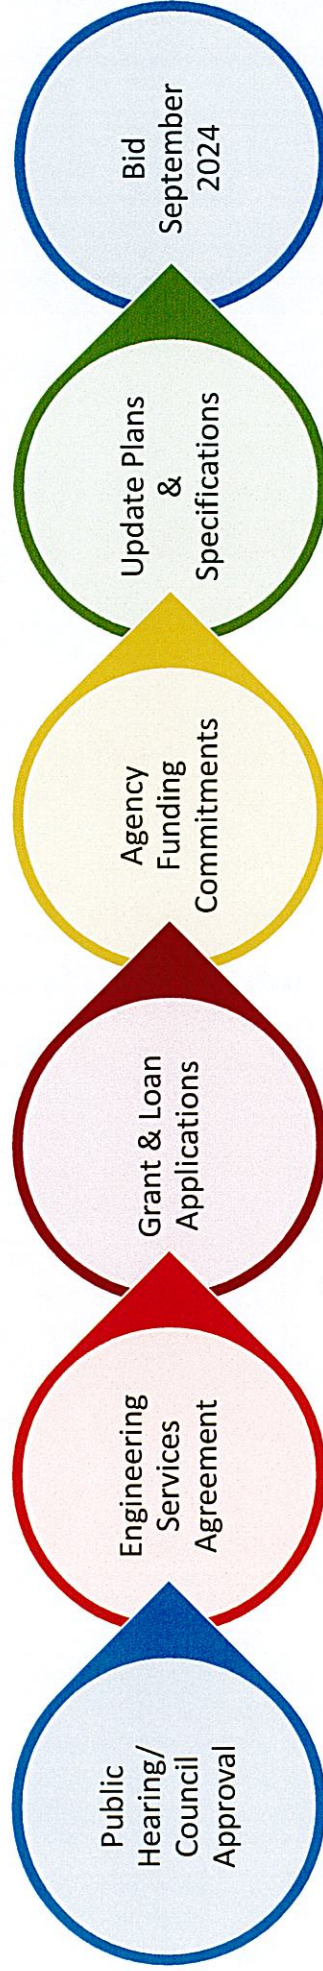

Trusted Experts | Innovative Results

# Questions

